



B-3 LEVEL MER PART PLAN

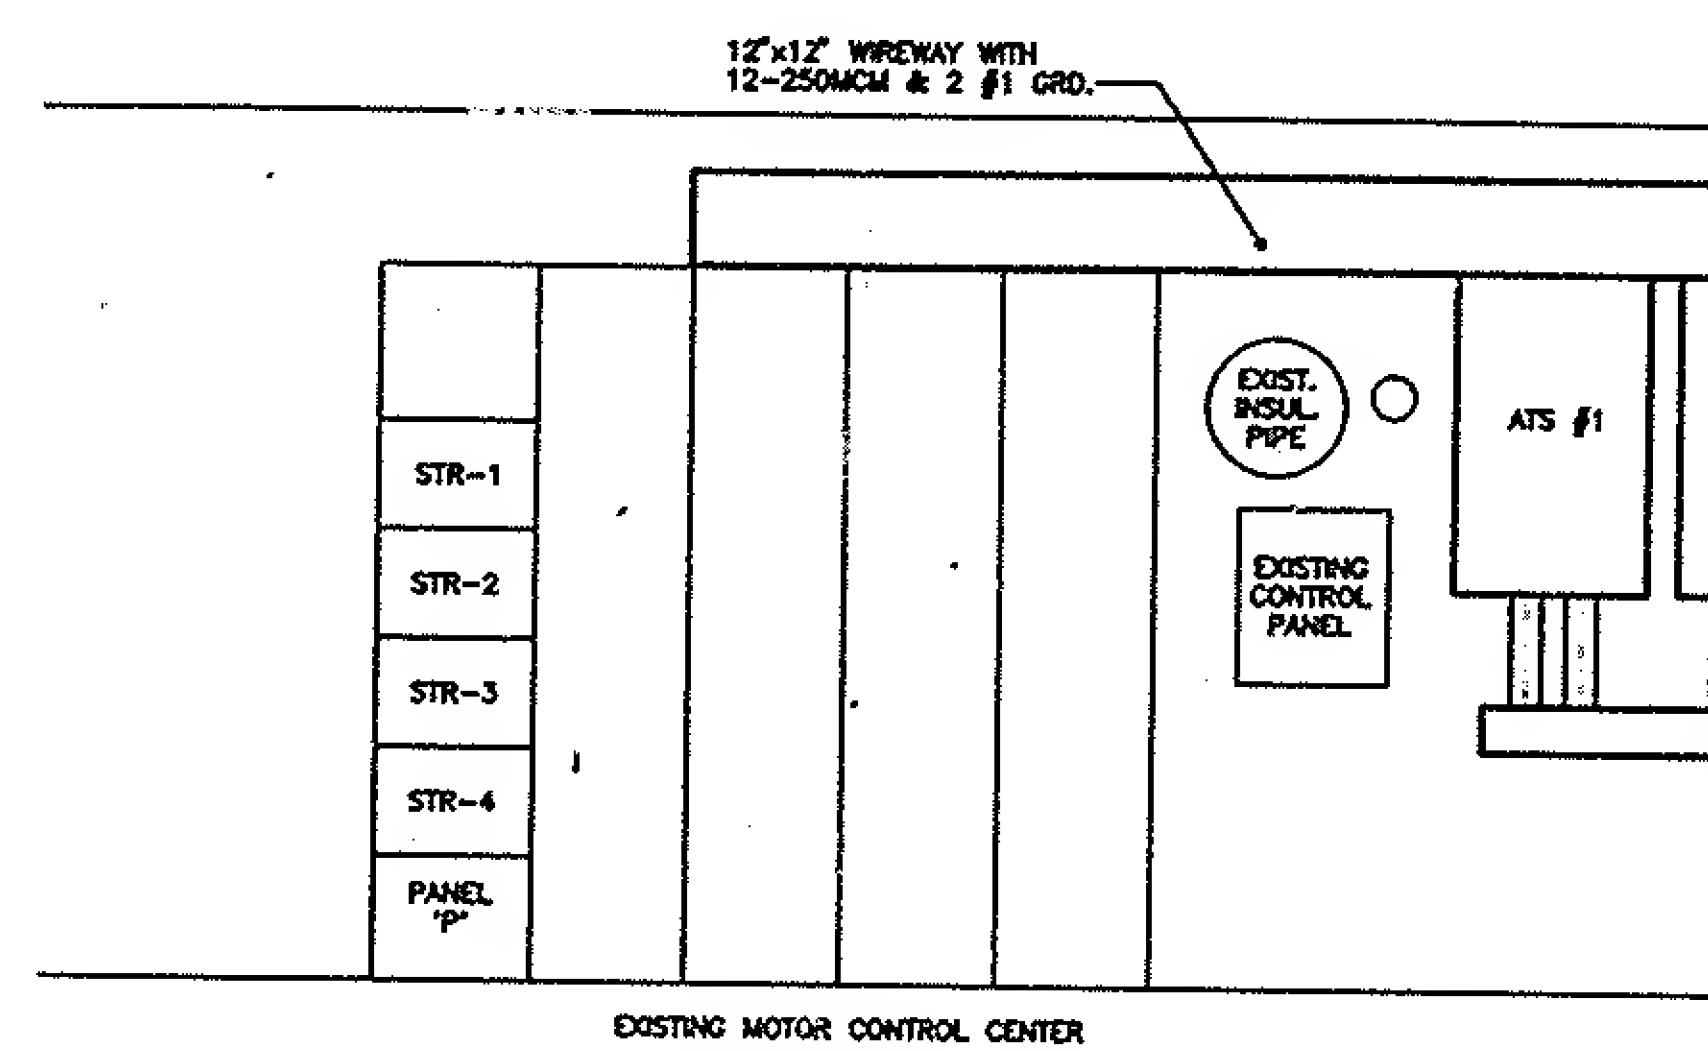

WEST WALL ELEVATION-EQUIPMENT LOCATION
NOT TO SCALE

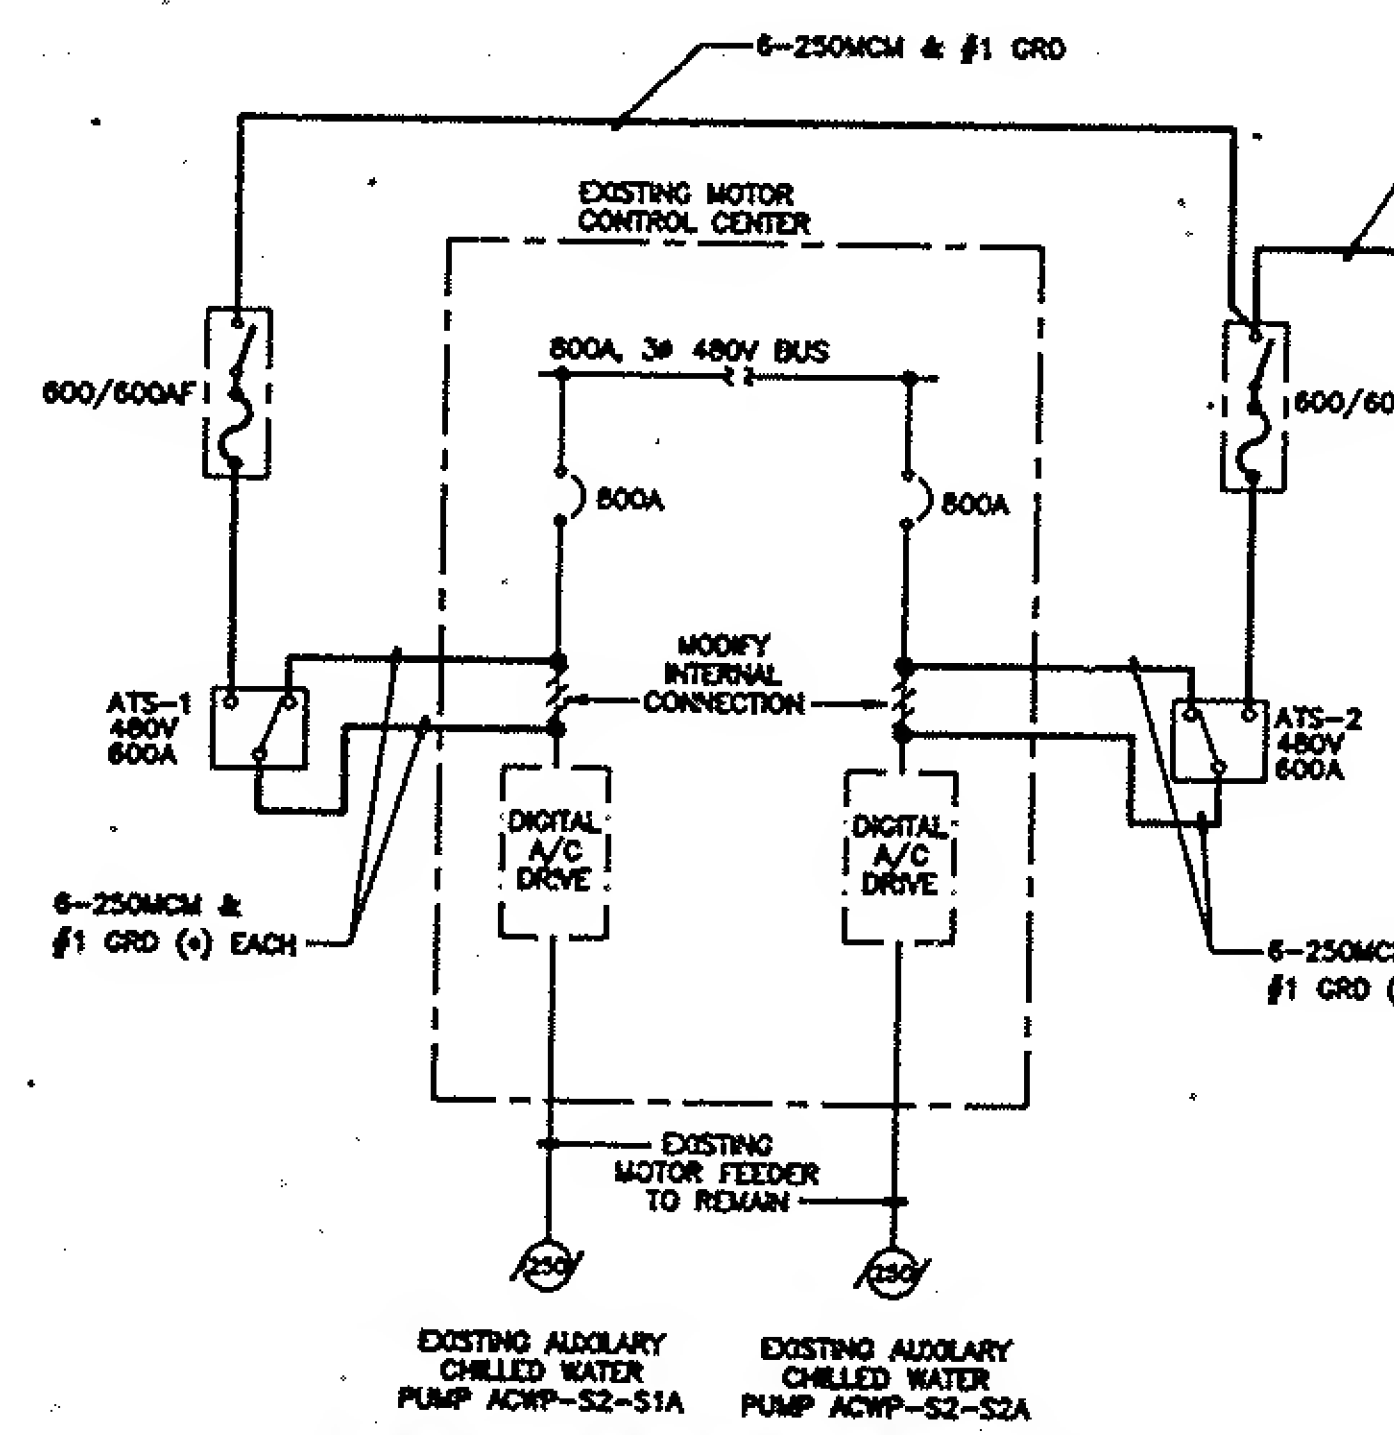

ONE-LINE DIAGRAM

WIRING MODIFICATIONS TO PROVIDE
EMERGENCY POWER FOR OPERATION OF
ONE AUXILIARY CHILLED WATER PUMP ON
POWER FAILURE

* CABLES SHALL BE INSTALLED IN COMMON 12"x12" WIREWAY.